

# Diagnosis of Power Transformer Faults based on different Fuzzy Method

Seema<sup>1</sup>, Mr. Ashish Nandal<sup>2</sup>

<sup>1</sup>(M. Tech, Scholar, RIEM, MDU Rohtak, Haryana, INDIA)

<sup>2</sup>. Mr. Ashish Nandal (AP, ECE Deptt, RIEM, MDU, Rohtak, Haryana, INDIA)

**Abstract:** Dissolved Gas Analysis is one of the most useful methods to detect incipient faults in transformer. Amongst the conventional DGA methods, IEC three ratio methods is widely used. One of the disadvantages in its present form is that a significant number of DGA results in-service fall outside the existing IEC codes and cannot be diagnosed. To overcome this limitation, additional eighteen new combinations to the existing nine are proposed in this paper. Further, Ratio codes are quantized to define the crisp boundaries of 0,1 and 2. In practice these boundaries are non crisp (Fuzzy) especially under multiple faults condition. These codes could lead to errors in diagnosis moving across the crisp boundaries from one fault to another. To overcome these limitations, Five Fuzzy ratio methods for diagnosis of multiple faults are developed. The paper used 100 different cases to test the accuracy of these methods in interpreting the transformer condition.

**Key-words:** Expert System (ES), Dissolved Gas Analysis (DGA), International Electro Commission Method (IEC), Incipient Faults, Power Transformer, Fault Diagnosis, Fuzzy Diagnostic System, Ratio Methods.

## 1. Introduction:

Power transformer is major component of power system which has no substitute for its major role. A transformer may function well externally with monitors, while some incipient deterioration may occur internally to cause fatal problem in later development. Nearly 80 % of faults result from incipient deteriorations. Therefore, faults should be identified and avoided at earliest possible stage by some predictive maintenance technique. Like any diagnosis problems, diagnosis of an oil-immersed transformer is a skilled task. Dissolved Gas Analysis (DGA) is reliable technique for detection of incipient faults in oil filled power transformer. Like a blood test or a scanner examination of the human body, it can warn about an impending problem, give an early diagnosis and increase the chances of finding the appropriate

cure. The operating principle [1]-[3] is based on slight harmless deterioration of the insulation that accompanies incipient faults, in the form of arcs or sparks resulting from dielectric breakdown of weak or overstressed parts of the insulation, or hot spot due to abnormally high current densities in conductors. Whatever the cause, these stresses will result in chemical breakdown of some of the oil or cellulose molecules of the dielectric insulation. The main degradation products are gases, which entirely or partially dissolve in the oil where they are easily detected at the ppm (per part million) level by Gas Chromatography [4]-[9]. It is a technique of separation, identification and quantification of mixtures of gases. By using gas chromatography [4]-[9] to analyze the gases dissolved in transformer's insulating oil, it becomes feasible to judge the incipient fault types. The main gases formed as a result of electrical and thermal faults in transformers and evaluated by chromatography are H<sub>2</sub>, C H<sub>4</sub>, C<sub>2</sub> H<sub>2</sub>, C<sub>2</sub> H<sub>4</sub>, C<sub>2</sub> H<sub>6</sub>, CO, CO<sub>2</sub>. Their relative proportions have been correlated through empirical observations and laboratory simulations, with various types of transformer encountered in service. Even under normal transformer operational conditions, some of these gases may be formed inside. Thus, it is necessary to build concentration norms from a sufficiently large sampling to assess the statistics.

## 2. DGA interpretation

If an incipient fault is present, the individual gas concentration, Total Combustible Gas (TCG) [10] and generating rate [10]-[12] are all significantly increased. Many DGA interpretative methods such as Key gas method [13]-[14], Dornerburg [13]-[15], Rogers [16] have been reported. Each of these techniques has its own advantages and limitations. These techniques do not necessarily reach to the same conclusion. The accuracy depends upon the expertise of the person handling the analysis. DGA is not science, but an art. The most widely used ratio method for this purpose is the IEC Standard 60599 [11] which is depicted in Table

1. One of the disadvantages in its present form is that a significant number of DGA results in-service fall

outside the existing IEC codes and cannot be diagnosed. To overcome this limitation, additional eighteen new combinations to the existing nine are proposed in this paper, which are displayed in Table 2.

**3. Proposed diagnostic expert system** Expert system is one of the areas of Artificial Intelligence (AI) which has moved out from research laboratory to the real world and has shown its potential in industrial and commercial applications. An expert system is a computer system which can act as human expert within one particular field of knowledge. The expert system embodies knowledge about one specific problem domain and possesses the ability to apply this knowledge to solve problem domain. Ideally the expert system can also learn from its mistakes and gain experience from its successes and failures. The system should be able to explain the reasoning behind the way in which it has aimed at a particular conclusion.

### 3.1 Selection of development Tool

For the development of any expert system, there should be proper selection of a development tool. The different packages i.e., VP-Expert, Shell, Rule master, etc. can also be used for development, but these packages have their own limitations, since they use their own rules and instructions. But a computer language is more flexible and the user can develop his methodology for the program formulation. So instead of using package, we can use computer language for expert system development. The language chosen should be simple and declarative. 'MATLAB' has these facilities. With the help of this interface, the capability of tracing, explaining and training in an expert system is greatly signified.

### 3.2 Experienced diagnostic procedure

As shown in figure 1, the overall procedure of routine maintenance for transformer is listed. The core of this procedure is based on the implementation of DGA techniques. The gas ratio Method is a significant knowledge source. The Key gas method [13]-[14], Dornenburg [13]-[15], Rogers [16] and IEC [10]-[12]. approaches have been implemented together. The single

ratio method is unable to cover all possible cases, other diagnostic expertise should be used to assist this method. Synthetic expertise method and database records have been incorporated to complete these limitations.

The first step of this diagnostic procedure begins by asking DGA for a sample to be tested, more important information about transformer's condition such as VA rating, Voltage rating, volume of oil and date of installation of transformer must be known for further inference. single ratio method is unable to cover all possible cases, other diagnostic expertise should be used to assist this method. Synthetic expertise method and database records have been incorporated to complete these limitations.

The first step of this diagnostic procedure begins by asking DGA for a sample to be tested, more important information about transformer's condition such as VA rating, Voltage rating, volume of oil and date of installation of transformer must be known for further inference. If the transformer is not degassed after previous diagnosis, then rate of evolution of total combustible gases TCG [10]-[12] is found. If rate of evolution is normal (less than 2.8 litre/day), further diagnosis can be bypassed. For abnormal rate of TCG [10-12], Permissible limits for different gases are checked. If gas concentrations exceed permissible limits, different DGA interpretative methods [10-16] are used to diagnose transformer fault type. If all methods give different results, proposed system diagnosis is adopted. If gas ratios lie in the boundary of the ratio codes, fuzzy diagnostic expert system is used. Probable multiple faults are diagnosed. After these procedures, different severity degrees are assigned to allow appropriate maintenance suggestions.

### 4. Fuzzy diagnostic expert system

There are lots of indeterminate factors in process of transformer fault diagnosis whose influence to the transformer operation status is usually fuzzy and uncertain. Ratio codes are quantized to define the crisp boundaries of 0,1 and 2. In practice these boundaries are non crisp (Fuzzy) especially under multiple faults condition. These codes could lead to errors in diagnosis moving across the crisp boundaries from one fault to another. To overcome these limitations, Fuzzy System for diagnosis of multiple faults is developed.

Table 1  
 IEC/IEEE codes for the interpretation of DGA results

$C_2H_2 / C_2H_4$	$CH_4 / H_2$	$C_2H_4 / C_2H_6$	Range of gas ratio
0	1	0	< 0.1
1	0	0	0.1-1
1	2	1	1-3
2	2	2	Greater than 3
$C_2H_2 / C_2H_4$	$CH_4 / H_2$	$C_2H_4 / C_2H_6$	Characteristic Fault
0	0	0	Normal ageing.
0	0	1	Thermal fault of low temp <150 Deg. C.
0	1	0	Partial discharge of low energy density.
0	2	0	Thermal fault of low temp between 150-300 Deg. C.
0	2	1	Thermal fault of medium temp between 300-700 Deg. C.
0	2	2	Thermal fault of high temp >700 Deg. C.
1	0	1	Discharges of low energy, Continuous sparking.
1	0	2	Discharge of high energy, Arcing.
1	1	0	Partial discharge of high energy density, Corona.

Table 2  
 Additional codes for the interpretations of DGA results

$C_2H_2 / C_2H_4$	$CH_4 / H_2$	$C_2H_4 / C_2H_6$	Characteristic Fault
0	0	2	Partial discharge of low energy
0	1	1	Thermal fault of low temp between 150-300 Deg. C
0	1	2	Thermal fault of low temp <150 Deg. C.
1	0	0	Flashover, Intermittent sparking
1	1	1	Thermal fault of low temp between 150-300 Deg. C.
1	1	2	Thermal fault of high temp >700 Deg. C.
1	2	0	Core and tank circulating currents.
1	2	1	Winding Circulating currents.
1	2	2	Core and tank circulating currents.
2	0	0	Partial discharge of high energy density, Corona
2	0	1	Discharge of high energy, Arcing.
2	0	2	Discharges of low energy, Continuous sparking
2	1	0	Partial discharge of high energy density, Corona
2	1	1	Discharge of high energy, Arcing.
2	1	2	Discharges of low energy, Continuous sparking
2	2	0	Severe arcing, Overheating of oil.( > 1000 Deg. C)
2	2	1	
2	2	2	

#### 4.1 Fuzzy set description

An ordinary set can be characterized as a binary

function. Elements in the set can be assigned to 1 and remaining elements of the universe can be assigned to 0. The

function is generalized so that value assigned to the elements of the universal set located within a specified

Range which indicates membership grades of these elements within the sets, such function is called membership function [17-20] and the corresponding set is a fuzzy set.

#### 4.2 Fuzzy inference system (FIS)

Sugeno method [21-24] is most commonly used fuzzy inference method.

A typical rule in Sugeno fuzzy model has the form, if input1 =x and input2=y, then output z=ax+by.

The output level z of each rule is weighted by firing strength w of the rule.

For example, if input1 =f(x) and input2=f(y) ,then firing strength  $w_i = \text{AND method } (F_1(x), F_2(y))$ ,

Where  $F_1(x)$  and  $F_2(y)$  are the membership functions for input1 and input2.The final output of the system is weighted average of all the rule output which is given as,

$$\text{Final Output} = \frac{\sum_{i=1}^N w_i z_i}{\sum_{i=1}^N w_i} \quad (1)$$

Where N is number of rules. Sugeno rule operates as per diagram shown in Fig.2

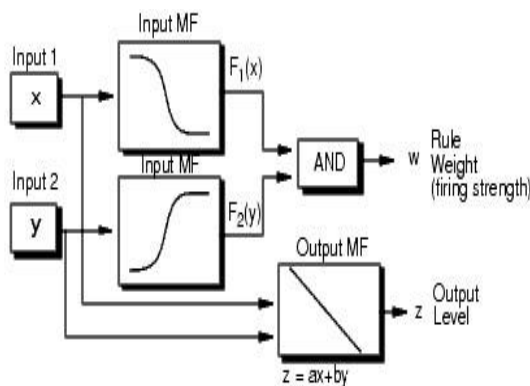


Fig.2 Sugeno Model

#### 4.3 Proposed fuzzy control algorithm

The proposed FIS editor prepared using MATLAB Fuzzy Logic Toolbox is shown in Fig.3.

This fuzzy system consists of 3 ratios C2H2/C2H4 , CH4/H2 and C2H4/C2H6 as inputs. Each ratio is fuzzified as Very Low, Low, Medium, High and Very High according to membership intervals as defined in Table 3;

The membership boundaries of Low and High fuzzy are fuzzified by using triangular function.

$$T(u; a, b, c) = \begin{cases} 0 & \text{for } u < a \\ (u-a)/(b-a) & \text{for } a \leq u \leq b \\ (c-u)/(c-b) & \text{for } b \leq u \leq c \\ 0 & \text{for } u > c \end{cases}$$

The membership boundaries of other fuzzy ratios are fuzzified by using trapezoidal function.

$$T(u; a, b, c) = \begin{cases} 0 & \text{for } u < a \\ (u-a)/(b-a) & \text{for } a \leq u \leq b \\ 1 & \text{for } b \leq u \leq c \\ 0 & \text{for } u > c \end{cases}$$

Membership function for C2H4/C2H6 ratio is given in Fig.4.The fuzzy system comprises of two outputs showing probable mixed faults. Each output has 13

Fault type as membership functions which are shown in Table 4. Severity is assigned to each fault type on the basis of experienced field data .

System comprises of 125 rules. Each rule consists of two components which are the antecedent (IF part) and the consequent (THEN part).With the fuzzy logic technique, the partial membership may improve the number of matched cases as compared to the ordinary crisp theory. Some example of the fuzzy rules are shown in rule editor ( Fig.5) . For the development of suitable fuzzy control algorithm, Simulink model is developed in MATLAB which is given below (Fig.6).

Although the ratio codes rules appear strictly defined, borderline cases with gas ratios on or near the line between code 0, 1 or 2 allows fuzzy inference system to interpret membership function of these rules flexibly and classify these cases under two different fault types. In accordance with expert experience and field knowledge, severity can be assigned to each fault type. For the fuzzy logic control, Sugeno [21] model is used. FIS derives output fuzzy sets from judging all the fuzzy rules by finding the weighted average of all 125 fuzzy rules output.

### 5. Implementation of proposed expert system

An expert system is developed based on the proposed interpretative rules and diagnostic procedure of an overall system. To demonstrate the feasibility of this expert system in diagnosis, 100 DGA gas records supplied by power companies CPRI, BHEL and NTPC (India) have been tested. Accuracy is calculated in two different ways,

a) When considering only number of predictions, percentage accuracy is given as

Fuzzy	C <sub>2</sub> H <sub>2</sub> /	CH <sub>4</sub>	C <sub>2</sub> H <sub>4</sub> /
Very	U	U<0.	U
L	0.09<=U<	0.09<=U	0.9<=U
Medi	0.11<=U	0.11<=U	1.1<=U
H	2.9<=U<	0.9<=U	2.9<=U
Very High	U	U	U
	>	>	>

A  
P  
=  
(  
T  
R  
/

$$Tp) *100 \quad (2)$$

where TR is number of correct predictions and TP is total number of the predictions,

b) When considering total number of cases, percentage accuracy is given as

$$AR = (T_R / T_C) * 100 \quad (3)$$

Where Tc is total number of cases

Accuracy values for different methods are compared and summarised in Table 5.

Fuzzy Ratio For membership interval.

## 6. Case study

NTPC, Rourkela (India), Transformer- 34  
 Date of installation: 19/01/1994; 200MVA, 11KV /132KV; Volume of tank: 5000 litre  
 Concentrations of dissolved gases in ppm are shown in Table 6.

### 6.1 Results of sample (1) implementation:

Since transformer is degassed before sampling. Rate of TCG could not be determined. Since all gases are within limits, further diagnosis can be bypassed. There is normal ageing of transformer.

### 6.2 Results of sample (2) implementation:

Rate of TCG : 7.45litre /day  
 Rate of TCG is more than 2.8 litre/day (abnormal).  
 Check permissible limits. Gases exceeds permissible limits. Refer DGA interpretative methods for analysis.

#### 6.2.1. Key gas method:

Key gas C<sub>2</sub>H<sub>2</sub> exceeds permissible limit, Fault diagnosed is Arcing. Key gas C<sub>2</sub>H<sub>6</sub> exceeds permissible limit, Fault diagnosed is Overheating

Key gas CO exceeds permissible limit, Fault diagnosed is Insulation Overheating

### 6.2.2 Roger's Ratio method:

Actual ratios of CH<sub>4</sub>/H<sub>2</sub>, C<sub>2</sub>H<sub>6</sub>/CH<sub>4</sub>, C<sub>2</sub>H<sub>4</sub>/C<sub>2</sub>H<sub>6</sub> & C<sub>2</sub>H<sub>2</sub>/C<sub>2</sub>H<sub>4</sub> are 3 0.4 1 3

Codes for the ratios CH<sub>4</sub>/H<sub>2</sub>, C<sub>2</sub>H<sub>6</sub>/CH<sub>4</sub>, C<sub>2</sub>H<sub>4</sub>/C<sub>2</sub>H<sub>6</sub> & C<sub>2</sub>H<sub>2</sub>/C<sub>2</sub>H<sub>4</sub> are 2 0 1 2

Diagnosed fault: Fault is unidentifiable

### 6.2.3. Dornenburg Ratio method :

Actual ratios of CH<sub>4</sub>/H<sub>2</sub>, C<sub>2</sub>H<sub>2</sub>/C<sub>2</sub>H<sub>4</sub>, C<sub>2</sub>H<sub>2</sub>/CH<sub>4</sub> & C<sub>2</sub>H<sub>6</sub>/C<sub>2</sub>H<sub>2</sub> are 3 3 1.1 0.3

Fault is unidentifiable.

### 6.2.4 IEC method :

Actual ratios of C<sub>2</sub>H<sub>2</sub>/C<sub>2</sub>H<sub>4</sub>, CH<sub>4</sub>/H<sub>2</sub> & C<sub>2</sub>H<sub>4</sub>/C<sub>2</sub>H<sub>6</sub> are 3 3 1

Codes for ratios of C<sub>2</sub>H<sub>2</sub>/C<sub>2</sub>H<sub>4</sub>, CH<sub>4</sub>/H<sub>2</sub> & C<sub>2</sub>H<sub>4</sub>/C<sub>2</sub>H<sub>6</sub> are 1 2 1

Diagnosed fault: Fault is unidentifiable

Codes for the sample fall outside the existing IEC codes, Hence fault cannot be diagnosed. Use Proposed System for the further diagnosis.

## 7. Conclusion

Prototype expert system is developed on a PC using 'MATLAB'. It can diagnose the incipient faults of the number of predictions of fault is 100 % for the both Proposed Diagnosis method (with and without fuzzy). Considering number of correct prediction, IEC method has highest efficiency. But, Number of predictions by IEC method is much less than the proposed diagnosis; hence efficiency considering total number of cases is much less than Proposed Diagnosis. By using Fuzzy diagnosis, number of correct predictions is increased considerably. This work can be continued to expand the knowledge base by adding any new experience, measurement and analysis techniques.

## References:

- [1] Mayoux C, On the Degradation of Insulating Materials With standing Electrical Stress, *IEEE Transactions on Dielectrics and Electrical Insulation*, Vol-7, Oct 2000.
- [2] Pradhan M.K., Assessment of Status of Insulation during Thermal Stress Accelerated Experiments on Transformer Prototypes, *IEEE Transactions on Dielectric and Electrical insulation*, Volume 13, issue 1, 2006 , page(s): 227-237.
- [3] Yves Leblanc, Roland Gilbert, Jocelyn Jalbert, Michel Duval , Joseph Hubert , Determination of Dissolved Gases and Furan -Related Compounds in Transformer Insulating Oils in Single Chromatographic Run by headspace /Capillary Gas Chromatography, *Journal of Chromatography, Elsevier*, Vol.657, Issue 1, December 1993, pp 111-118.
- [4] Agah M, Lambertus GR., Sacks R, Wise K, High Speed MEMS -Based Gas Chromatography, *Journal of Micro electromechanical Systems*, Volume-15, Issue 5, 2006, pp 1371-1378.
- [5] Agah M, Lambertus GR., Sacks R, Wise K, Potkay J.A., High Performance Temperature Programmed Micro fabricated gas Chromatography Columns, *Journal of Micro electromechanical Systems*, Volume14, issue
- [6] N.A. Muhamad, B.T. Phung , T.R.Blackburn, K.X.Lai, Comparative Study and Analysis Of DGA Methods for Transformer Mineral Oil, *IEEE Conference Power Tech*, Lausanne, proceeding , 2007 , pp 45-50.
- [7] N. A. Muhamad , B .T. Phung , T.R.Blackburn, Comparative Study and Analysis of DGA Methods for Transformer Mineral Oil using Fuzzy Logic, *IEEE Power Engg. Conference*, Singapore 2007, pp 1301-1306.
- [8] E. Dornerburg, W.Strittmatter, Monitoring Oil Cooling Transformers by Gas Analysis, *Brown Boveri Review*, 61, May 1974, pp 238- 247.
- [9] R.R.Rogers, IEEE and IEC Codes to Interpret Incipient Faults in Transformers, Using Gas in Oil Analysis, *IEEE Trans. E.I.*, Vol. EI -13, NO.-5, Oct 1978, pp 349-354,.
- [10] L.A.Zadeh, The role of Fuzzy Logic in the Management of Uncertainty in Expert System, *Fuzzy sets and systems*, Nov 1983, pp 199-227,.
- [11] Yann- Chang Huang, Hong-Tza Yang, Ching-Lien Hnany, Developing a New Transformer Fault Diagnosis System Through Evolutionary Fuzzy Logic, *IEEE Trans. on Power Delivery*, Vol.12, No.2, April 1997.