

# Vibration Analysis of Fiber Reinforced Plastic Fan Blade

Khandare R.S<sup>1</sup>, Londhe B.C.<sup>2</sup>, Ganore D.J.<sup>3</sup>

<sup>1</sup>Assistant professor, Department of mechanical Engg., SND COE & RC, Maharashtra, India

<sup>2</sup> Assistant professor, Department of mechanical Engg., SND COE & RC, Maharashtra, India

<sup>3</sup> Assistant professor, Department of mechanical Engg., NIT, Maharashtra, India

**Abstract-** *Abstract Structural vibration problems causes a major hazard and design limitations for a very wide range of engineering products. The Aim of this paper is to analytically extract the natural frequencies of cooling tower fan blades of different sizes. So that, Designer can ensure that natural frequencies will not be close to the frequency of the main excitation forces in order to avoid resonance. Three dimensional models of blades have been developed in Unigraphics NX 5 and modal analysis is carried out by ANSYS 15. Also, an experimental study carried out for FRP composite blades. Concurrence between ANSYS results and Experimental results has been found for the frequency range of interest.*

**Key Words:** *Vibration analysis, Cooling Tower Fan Blade, Ansys, FFT Analyzer.*

## 1. INTRODUCTION

Cooling tower fan blades are exposed to severe conditions of excitation and vibration during their service life. Thus it may have a negative effect on their dynamic behaviour and this may lead to structural damage that is the collapse of cooling tower. Consequently, it is necessary to undertake vibration analysis, so that the excitation of the blade to their natural frequencies and therefore the resonance phenomenon can be avoided. Under these circumstances, the blade structure must be designed strong enough to operate under the range of frequency interest, withstand the severe conditions and survive the maximum resistance to fatigue. To achieve these requirements, glass fiber-reinforced composites are frequently used in such structural applications, Because of their excellent formability, their mass saving advantage, their high stiffness-to-density and strength-to-density ratios and the greater freedom to use these properties in the desired orientation and position. Furthermore, these lightweight structural materials have some precise objectives, which cannot be reached with some other

conventional materials. These attractive advantages have positively led to integrate such materials in the construction of cooling tower fan blades. In order to minimize vibration problems a vibration analysis is carried out on blades made of different dimensions and use for various applications. A lot of research is done on vibration analysis of different types of blades by different methods. The frequencies at which vibration naturally occurs, and the modal shapes, which the vibrating system assumes, are properties of the system, and can be determined by doing Modal Analysis using ANSYS. Detailed modal analysis determines the fundamental vibration mode shapes and corresponding frequencies. Now, for a particular problem it is needed to find an analytical solution to determine natural frequency of non-uniform, tapered FRP composite blades of various dimensions and also to develop a program to predict the natural frequency of FRP fan blades. A vibration analysis of non-uniform, tapered, composite blade has been carried out by analytical method, and experimental method.

## 1.1 Problem Definition

The objective of this paper is to,

- 1) Find natural frequency of FRP fan blade by performing model analysis in Ansys.
- 2) Measurement of natural frequency by using FFT analyzer.
- 3) To set the natural frequency series for 24 ft, 26 ft, 30 ft Fan blades.

## 1.2 Methodology

A vibration analysis of non-uniform, tapered, composite blade has been carried out by model analysis and experimental method. A FRP composite blade can be considered as a stepped, taper, continuous cantilever beam. The circular section of FRP blade has been fixed. Ansys simulation has been done by doing modal analysis using commercial software ANSYS Workbench. A three dimensional model of blades has been generated in UNIGRAPHICS (NX5). A modal analysis in Ansys is carried out. In modal analysis, first refresh the material and

geometry then do meshing, further in an analysis system select number of modes required, Apply fixed support at circular section of the blade then, Find the solution. The Solution gave natural frequencies and corresponding mode shapes and Total deformation. An Experimental method to find natural frequency of FRP composite blades required experimental setup consist of a composite blade considered as a cantilever beam, Circular end of the blade was fixed. The Accelerometer was put on the tip on blade, accelerometer connected to FFT analyzer. After initial disturbance by hammering on tip of blade analyzer display indicates values of the natural frequency of FRP composite blades. A comparison has been made between ANSYS results and Experimental results.

## 2. SPECIFICATION OF BLADE

Table -1: Design Data for 24ft, 26ft, 30ft Blade

Blade design data for 24ft, 26ft, 30ft blades. (STD. Chord, Distance are in mm)									
Sr. No.	Twist Angle	STD. Chord 24'	Distance	Twist Angle	STD. Chord 26'	Distance	Twist Angle	30 STD' Chord	Distance
00	18.50	550	285	24.00	603	305	18.50	630	285
01	17.50	537	182	22.50	585	200	17.50	610	230
02	14.50	511	182	21.00	562	195	14.50	585	230
03	12.50	492	182	19.50	542	195	12.50	564	230
04	10.50	473	182	8.00	520	195	10.50	542	230
05	8.00	453	182	16.50	499	195	8.00	520	230
06	6.50	434	182	15.00	478	195	6.50	498	230
07	5.00	414	182	13.50	456	195	5.00	475	230
08	4.00	395	182	12.50	435	195	4.00	453	230
09	3.25	376	182	10.50	413	195	3.25	430	230
10	2.75	356	182	9.00	391	195	2.75	407	230
11	2.25	337	182	7.50	370	195	2.25	385	230
12	1.25	318	182	6.00	348	195	1.25	363	230
13	1.00	298	182	4.50	326	195	1.00	340	230
14	0.60	279	182	3.00	305	195	0.60	318	230
15	0.30	259	182	1.50	283	195	0.30	295	230
16	0.00	240	182	0.00	262	195	0.00	272	230

Table -2: Material Properties of Frp Composite

FRP Material	Young's Modulus (E) (N/mm <sup>2</sup> )	Poisson's ratio (μ)	Density (ρ) (Kg/mm <sup>3</sup> )
Glass fiber epoxy	13425	0.265	1.76*10 <sup>(-03)</sup>

## 3. ANSYS SIMULATION FOR CALCULATION OF NATURAL FREQUENCY

### 3.1 Following Steps are carried out in Modal Analysis by ANSYS Workbench.

- 1) Build the model:- A three dimensional model of blades has been generated in UNIGRAPHICS (NX5.) and saved as a STEP file or IGES format.
- 2) Choose analysis type in Ansys Workbench:- Modal analysis has been selected

- 3) Import Model:- A 3-D model of FRP blade whose analysis was to be done has been imported in Ansys Workbench in STEP File or IGES format.
- 4) Input Material Properties:- Frp composite material was unavailable, the FRP material of required material properties has been generated.
- 5) Refresh the material and Geometry:- In modal analysis refreshed material and geometry.
- 6) Meshing:- Element type has been defined and did meshing.
- 7) Boundary conditions:- In an analysis system numbers of modes required were selected. In order to apply constraints, a fixed support was applied at root of blade i.e. at circular section of FRP blade. External loads Ignored since free vibrations has been assumed.
- 8) Solution:- Total deformation and modal parameters has been found.

## 3.2 Results of ANSYS Simulation

In this section modal analysis has been done by use of Ansys software. It involves study of different modal parameters of system. Ansys simulation has been used to analyze the modal parameters of various FRP blades. Thus avoiding the need for carrying out several experiments which is time consuming and costly. The results presented ahead are the List of natural frequencies, Mode shapes and Total deformation for 24ft, 26ft, 30ft FRP blades.

### 3.2.1 Natural frequencies for 24FT FRP fan blade.



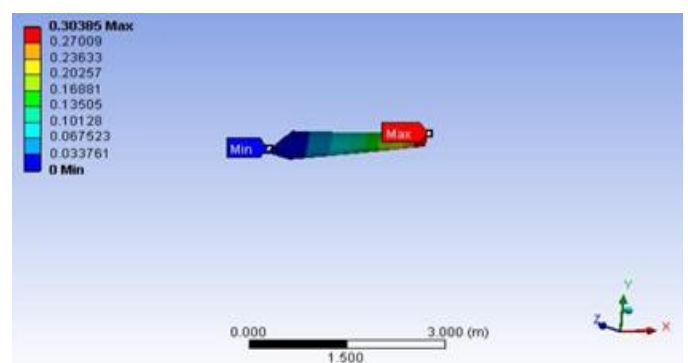



Fig -1: Total Deformation plots- mode 01 of 24 ft. blade corresponding to Frequency 6.08 Hz.

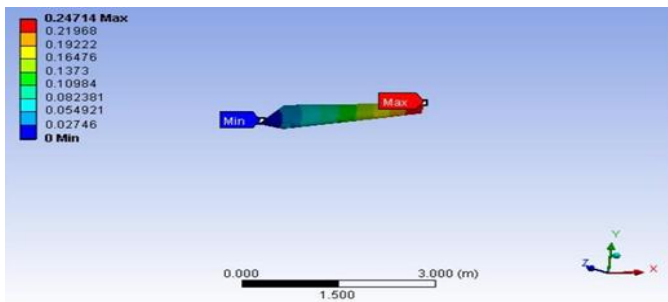

**Fig -2:** Total Deformation plots-mode 02 of 24 ft. blade corresponding to Frequency 10.81 Hz.

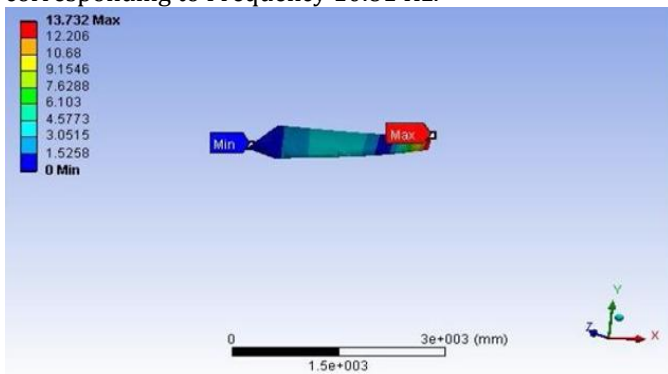

**Fig -3:** Total Deformation plots- mode 03 of 24 ft. blade corresponding to Frequency 22.32 Hz.

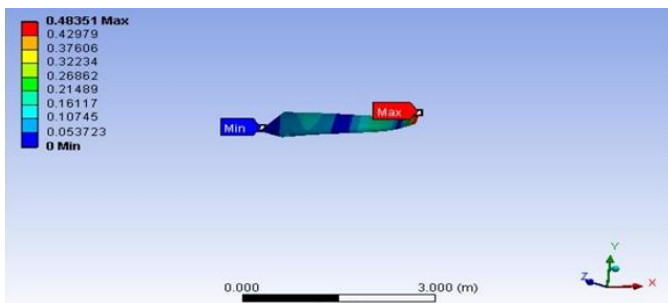


**Fig-4:** Total Deformation plots-mode 04 of 24 ft blade corresponding to Frequency 54.42 Hz.


**Table-3:** Natural Frequency of 1,2,3,4Modes for 24FT Blade.

Mode	Frequency [Hz]
1.	6.0882
2.	10.814
3.	22.584
4.	54.427


### 3.2.2 Natural frequencies, for 26ft FRP fan blade.

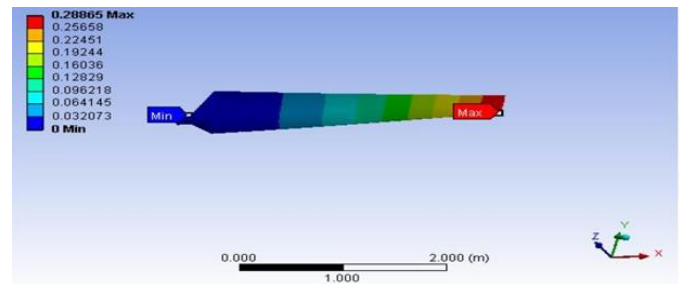


**Fig -5:**Total Deformation plots -mode 01 of 26 ft. blade corresponding to Frequency 4.39 Hz.

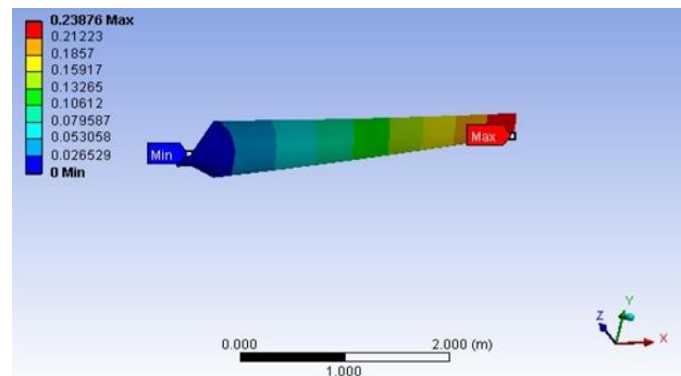

**Fig -6:** Total Deformation plots-mode 02 of 26 ft. blade corresponding to Frequency 10.97 Hz.

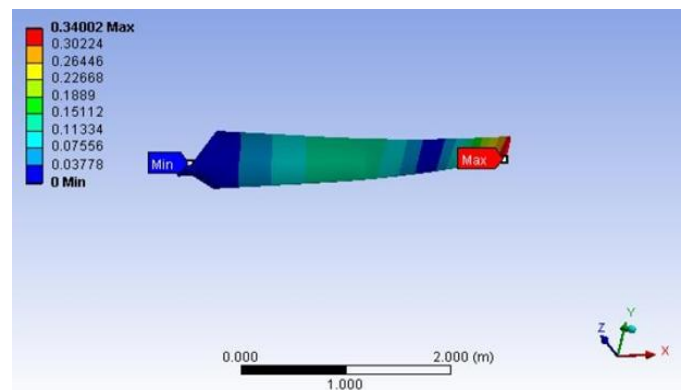

**Fig -7:**Total Deformation plots- mode 03 of 26 ft. blade corresponding to Frequency 17.82 Hz.

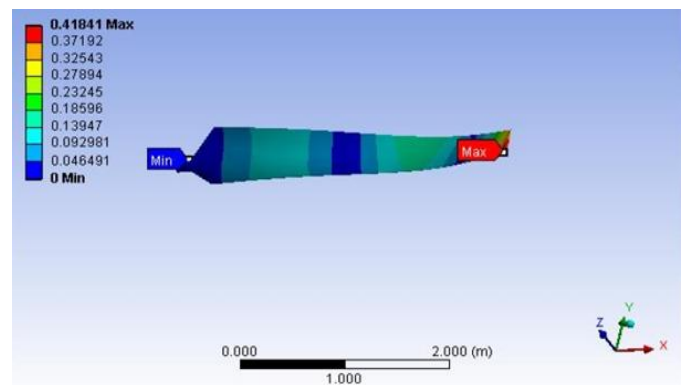


**Fig -8:**Total Deformation plots- mode 04 of 26 ft. blade corresponding to Frequency 44.98 Hz.


**Table -4:** Natural Frequency of 1,2,3,4 Modes for 26ft Blade.

Mode	Frequency [Hz]
1.	4.3947
2.	10.977
3.	17.823
4.	44.981


### 3.2.3 Natural frequencies for 30ft FRP fan blade

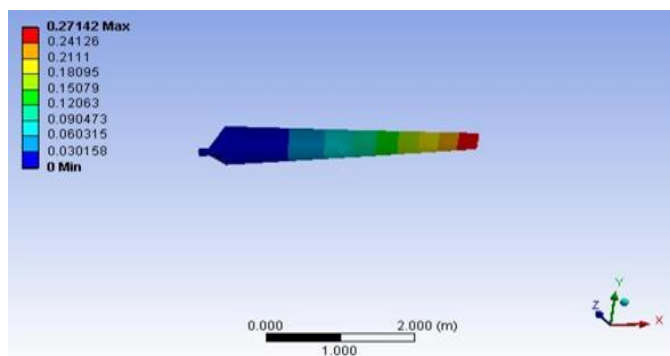


**Fig - 9:** Total Deformation plots- mode 01 of 30 ft. blade corresponding to Frequency 3.21 Hz.

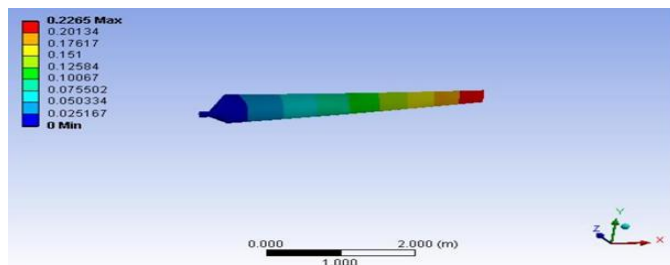

**Fig - 10:** Total Deformation plots- mode 02 of 30 ft. blade corresponding to Frequency 8.80 Hz.

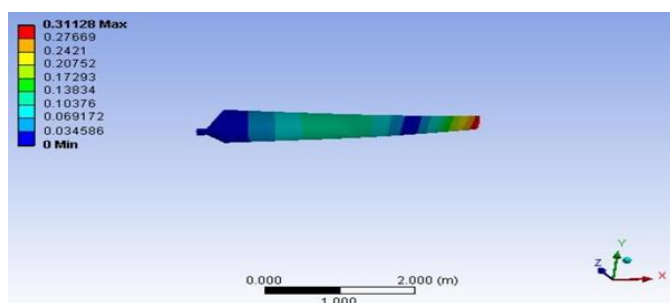

**Fig -11:** Total Deformation plots mode 03 of 30 ft. blade corresponding to Frequency 13.25 Hz.

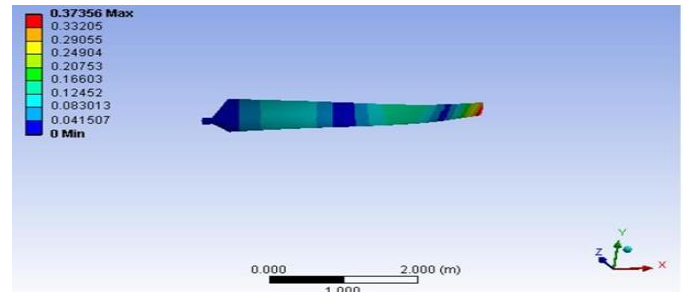

**Fig -12:** Total Deformation plots mode 04 of 30 ft. blade corresponding to Frequency 33.49 Hz.

**Table- 5:** Natural Frequency of 1,2,3,4 Modes for 30ft Blade.

Mode	Frequency [Hz]
1.	3.2145
2.	8.8072
3.	13.259
4.	33.49

## 4. EXPERIMENTAL WORK TO FIND NATURAL FREQUENCY OF FRP BLADES

### 4.1 Set up and instrumentation used

The tests were carried out on FRP composite blade. The block diagram of the experimental setup is shown in Fig. 13. Experimental setup consist of FRP composite blade hold as a cantilever beam as shown in Fig. 13. The accelerometer has been put on tip of blade and connected to FFT Analyzer. An accelerometer is used to sense amplitude of vibration. The analysis has been done with the help of FFT analyzer. The following instruments were used for measuring, recording and analyzing the natural frequency of FRP blades.

Accelerometer – make by – ADASH.

CF-0106 Connecting Cable – make by – ADASH.

Vibration analyzer- handheld FFT analyzer- ADASH.



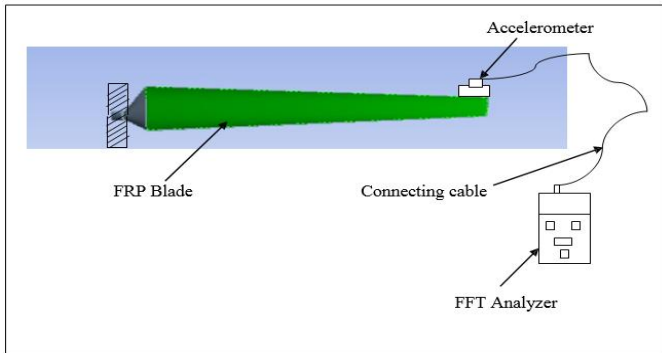


Fig -13:Block diagram of the experimental Set-up.

### 4.2 Measurement and analysis

The experimental set up as described in the earlier section has been used for measurement of natural frequency of FRP blades. This section gives details of experimental work carried out on FRP composite blades. The experimental results obtained have been compared with the Ansys results. For the determination of natural frequency a small disturbance given or hammered on tip of blade so, that the blade subjected to free vibration. Display of FFT analyzer displayed frequency plots. List of frequencies have been recorded for 24ft, 26ft, & 30ft FRP blades. Table -6 shows the experimentally obtained natural frequency for various FRP blades. The results are compared with the theoretically obtained results. From Result table it can be observed that there are good agreements between ANSYS results and Experimental Results. The Result table showing natural frequencies of FRP composite blades has been found by Experimental method.

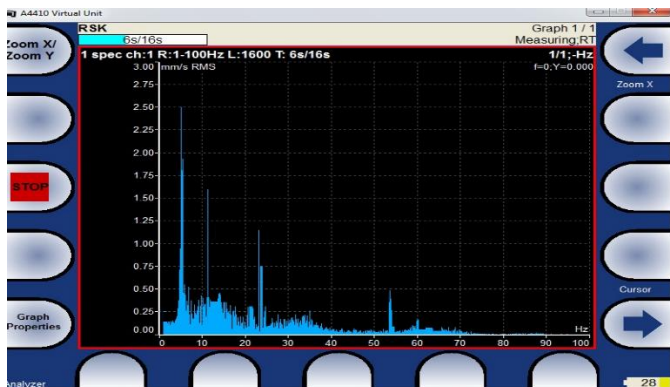


Fig - 14: Frequency Response for 24 ft Blade.



Fig -15: Frequency Response for 26 ft Blade.

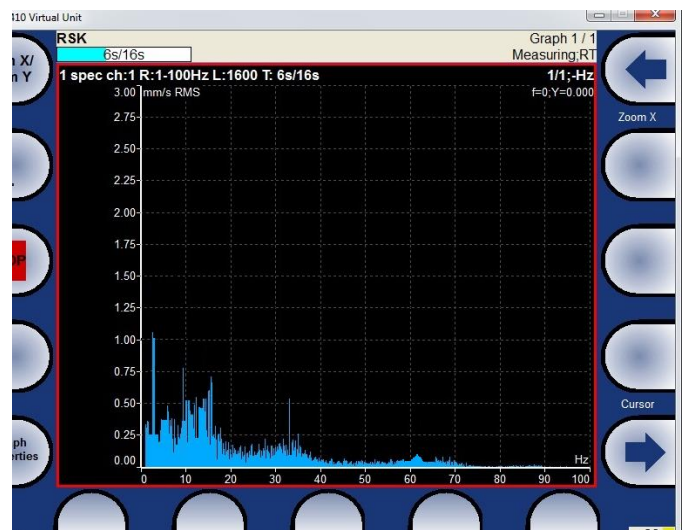


Fig -16: Frequency Response for 30 ft Blade.

Table - 6: Result table showing natural frequencies by Experimental method.

Blade Size	Mode 1	Mode 2	Mode 3	Mode 4
24 ft	7	9	24	52
26 ft	5	10	18	46
30 ft	4	9	14	33

### 5. COMPARISON OF ANSYS AND EXPERIMENTAL RESULT

Table-7: Comparison between Ansys Result and Experimental Results

Blade Size	Ansys				Experimental			
	Model 1	Mode 2	Mode 3	Mode 4	Model 1	Mode 2	Mode 3	Mode 4
24 ft	6.0882	10.814	22.58	54.42	7	9	24	52
26 ft	4.394	10.977	17.823	44.981	5	10	18	46
30 ft	3.214	8.807	13.259	33.49	4	9	14	33

## 6. CONCLUSIONS

As compared ANSYS results, with Experimental results, it is being observed that Good agreement between ANSYS results and experimental results has been found in the frequency range of interest for a FRP Composite blades. Ansys results are close to the experimental results. Therefore the above obtained natural frequencies can be considered while designing the FRP fan blades.

## ACKNOWLEDGEMENT

I am greatly indebted to professors and lecturers of Department of Mechanical Engineering, S.N.D. College of Engineering, Yeola, without whose advice and guidance this work would have never been possible. I am indebted to Department of Mechanical Engineering for giving me an opportunity to learn and do this paper work. I once again extend my sincere thanks to the entire college for all those who directly or indirectly involved in this work.

## REFERENCES

- [1] Dr. Luay S. Al-Ansari', "Calculating of Natural Frequency of Stepping Cantilever Beam", International Journal of Mechanical & Mechatronics Engineering IJMME- IJENS Vol: 1 2 No: 05.
- [2] 'Tartibu L.K., Kilfoil M. and Vander Merwe A.J.', "Vibration analysis of a variable length blade wind turbine", International Journal of Advances in Engineering & Technology, July 2012. ISSN: 2231-1963.
- [3] 'Choong-Yul Son , Jae-Kwon Choi' "An Experimental Study on the Vibration Characteristics of the Rotor Blade with Fiber Reinforced Plastics", Naval Architecture & Ocean Engineering, In-ha University, Yong-Hyun Dong, Nam- gu, Incheon metro city, South Korea.
- [4] 'Gunner C. Larsen, Morten H. Hansen, Andreas Baumgart, Ingemar Carl'en, "Modal Analysis of Wind Turbine Blades", Risø-R-1181(EN).
- [5] 'Zaid iqbal, Baig, abdul khan, Malik Ahemed', "Dynamic Behavior of thin composite plates", Pakistan air force Karachi institute, Karachi.
- [6] 'R Vasudevan, B Parthasaradhi, "Vibration Analysis of a Rotating Tapered Composite Beam with Tip Mass", ISBN: 978-93-81693-89-6.
- [7] 'Tayeb Chelirem and Bahi Lakhdar, "Dynamic study of a turbine tapered blade", SATRESET, Vol. 1, No. 4, December 2011, ISSN: 2046-6404.
- [8] 'Y. Bedjilili, A. Tounsi, H. M. Berrabah, I.Mechab, "Natural frequencies of composite beams with a variable fiber volume fraction including rotary inertia and shear deformation", Appl. Math. Mech. -Engl. Ed. 30(6), 717-726 (2009).
- [9] ' Lucio Raimondo, Lorenzo Iannucci, Paul Robinson, Silvestre T. Pinho, Paul T. Curtis', "predicting the dynamic behaviour of polymer composites", 16th international conference on composite materials.
- [10] 'S.S.Rao', "Mechanical vibrations", Fourth Edition, Pearson publication.