

# Microcontroller Based detection and protection of induction motor

Dipali Salave<sup>1</sup>, Priyanka Khade<sup>2</sup>, Jayashree Ghumare<sup>3</sup>, Rupal Khalane, Rahul Nikam<sup>5</sup>

<sup>1,2,3,4</sup> Student, Electrical Engineering, MET's Institute of Engineering, Adgaon, Nashik

<sup>5</sup>Professor MET's Institute of Engineering, Adgaon, Nashik

\*\*\*

**Abstract** - The fundamental aim of this project is to trip the relay if the fault is occurring in three phase induction motor. A low cost and reliable protection scheme has been designed which monitors the parameter of induction motor such as current, temperature and speed of motor. Circuit measures this parameter by CT, Tachometer, Temperature sensor and then the collected data will feed to the microcontroller. LCD will display the measured value if the measured value will cross the specified limit then GSM will send the measured value to the registered mobile number and relay will operate and supply is to be cut off and motor will stop. This type of protection takes fraction of seconds.

**Key words:** Induction Motor, GSM, PIC18 Microcontroller, Tachometer, CT.

## 1. INTRODUCTION

There are wide range of AC motor and motor characteristics because of all the numerous duties for these they are used. Induction motor is generally utilized as a part of industry due to their rigidity and speed control flexibility. Due to some power quality issues like overvoltage and under voltage and due to variation in current, fault are occur in induction motor. To overcome such type of fault we use some circuitry to protect the motor. In our project we use microcontroller PIC18F452 as a main part of our circuit. We use 5 input ports of microcontroller to interface tachometer, three CT's, and temperature sensor LM35. By using tachometer, CT's and temperature sensor we continuously collect data of speed, current and temperature respectively. By collecting these data microcontroller send these data to the mobile phone of the person who work on that motor. If current or temperature exceed the predetermine limit then this will sense by sensors and data will be displayed on the LCD and the emergency message will be send to the mobile phone through GSM model. And to protect the motor from over-current and over-temperature relay will trip and motor will stop. These all process of tripping the relay will take fraction of seconds. Our main objective of the project is to make cheap and reliable protection system for 3 phase induction motor.

## 2. Causes of damaging the induction motor

### 2.1 Over-current:

Over-current or exceed current is a situation where a larger than intended electric current exist through conduction, leading to excessive generation of heat, and the risk of fire or damage to induction motor.

### 2.1.1 Causes of Over-current

Miswiring can cause over-current in motors. If the wiring is incorrect on a motor, it can lead to shorts and other problems. If the phase-to-phase insulation breaks down, this can cause over-current. This insulation is intended to prevent the current from finding a circuit in an unintended place. Most electrical devices with complex wiring come with circuit breakers and fuses. These are intended to protect the devices from over-current. Circuit breakers generally must be bought to match the motor or device you are looking to regulate but fuses are almost universal, so that any fuses can be placed in any device. If either of these preventative devices breaks down, over-current can become a problem.

### 2.2. Overvoltage:

An overvoltage is an increase in the rms value of AC voltage greater than 110 percent or 0.11p.u. at the power frequency for a duration longer than 1 min. over voltages are usually the result of load switching (e.g., switching off a large load or energizing a capacitor bank). The over voltages result because either the system is too weak for the desired voltage regulation or voltage controls are inadequate. Incorrect tapsettings on transformers can also result in system over voltage

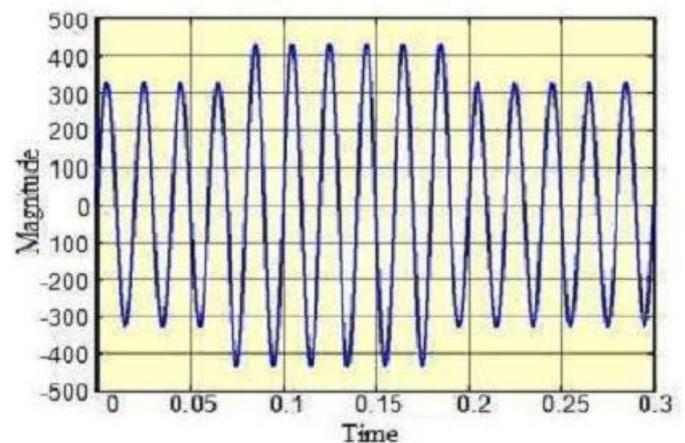


Fig 1: Waveform of over-voltage

### 2.2.1 Causes of Overvoltage:

- Due to poor voltage regulation
- Accidental contact to high voltage circuit.

According to IEEE 1159 Classification of overvoltage.

Types of Voltage	Duration	Magnitude
Instantaneous	0.5 - 30cycles	1.1 - 1.8p.u.
Momentary	30cycles - 3sec	1.1 - 1.4p.u.
Temporary	3sec - 1min	1.1 - 1.2p.u.

**Table 1:** Classification of Overvoltage

## 2.2 Over-temperature

Motor temperature is one of the factor which we should monitor and make sure that it should be in normal range. The Temperature of the motor is closely related with the winding temperature. If temperature exceeds the predetermined values then the winding insulation may become damage or weak. From that damage it will make the internal short circuit between winding phase and cause a serious damage to the induction motor.


### 2.2.1 Causes of Over-temperature

- High ambient temperature of motor
- Bearing jammed
- Under sizing motor capacity
- Not suitable voltage rated running in overload

## 2.3 Crawling

It has been observed that squirrel cage type induction motor has a tendency to run at very low speed compared to its synchronous speed, this phenomenon is known as crawling. The resultant speed is nearly 1/7<sup>th</sup> of its synchronous speed.

## 3. Circuit Diagram

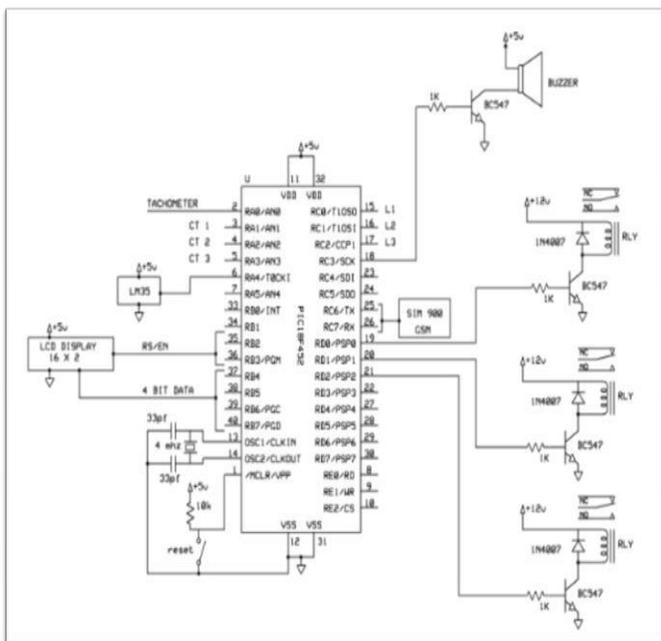

**Fig2:** Circuit diagram of detection and protection circuitry

## 3.1 Main Component Used In Circuit

1. Microcontroller PIC18F452
2. Bridge rectifier
3. Induction Motor
4. Temperature sensor LM35
5. Tachometer IC-LM2917 (Frequency to voltage IC)
6. Relay 12V ICO
7. GSM 900
8. LCD Display (16x2)
9. Three Current Transformer
10. Transformer


## 4. Description of above component:

### 4.1 Microcontroller PIC18F45

Microcontroller receives data from temperature sensor, Tachometer and CT then convert it from Analog to Digital LCD. Features:

- 5V DC
- 10bit ADC
- 40pin IC
- Flash Memory 32k
- On-chip RAM - 1536 bytes
- EEPROM - 256 bytes
- 4 Timers

### 4.2 Bridge rectifier

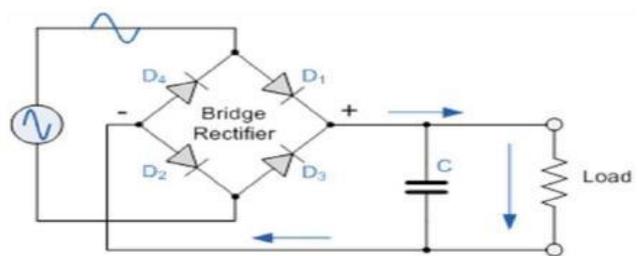

**Fig 3:** Bridge Wave Rectifier

We use bridge rectifier to get pure DC signal. Bridge rectifier is highly efficient than others. It consist of 4 diodes D1, D2, D3 and D4. When we gives AC supply to the circuit in positive half cycle D1 and D2 become forward biased and it will start conduction at the same time D3 and D4 are reverse biased hence it does not conduct. In negative half cycle D3 and D4 become forward biased and start conduction and D1, D2 become reverse biased and stop conduction.

### 4.3 Induction Motor:

An electrical motor is such an electromechanical device which converts electrical energy into mechanical energy.

Specification: 3phase squirrel cage induction motor, 415V, 0.5HP,50Hz, 4Pole, speed upto 1500rpm, Insulation class E or B(Hindustan Manufacturer).

#### 4.4 Tachometer:

IC-LM2917 frequency to voltage converter. The Lm2917 series are monolithic frequency to voltage converter with a high gain op-amp/comparator designed to operate a relay, lamp or other load when input frequency reaches or exceeds the selected rate.

$$V_{out}=F_{in}\times V_{cc}\times R_1\times C_1$$

#### 4.5 Temperature Sensor

The LM35 series are precision integrated-circuit temperature sensors, whose output voltage is linearly proportional to the Celsius (Centigrade) temperature.

#### 4.6 Relay:

A relay is an electrically operated switch. Many relays use an electromagnet to mechanically operate a switch, but other operating principles are also used, such as solid-state relays. Relays are used where it is necessary to control a circuit by a separate low-power signal, or where several circuits must be controlled by one signal.

#### 4.7 LCD display

Liquid Crystal Display is used for display the measured readings and if fault occur it also show on LCD. 16x2 LCD is used in circuit. It having 16 character and 2 rows.



Fig4: LCD display

#### 4.8 GSM 900

GSM is a cellular network, which means that cell phones connect to it by searching for cells in the immediate vicinity. There are five different cell sizes in a GSM network—macro, micro, pico, femto, and umbrella cells.

#### 5. WORKING

230V 50Hz supply is given to the step down transformer it convert 230 volt in 12-0-12V AC. 12V directly given to relay

because our relay work on 12V AC remaining 12V AC is given to bridge circuit. Bridge circuit convert that 12V AC into 12V DC. As our all component like microcontroller, LCD display is work on 5V AC. The 5V AC supply given through IC to the other component. Once the circuit is energized tachometer continuously take the readings of speed, CT gives reading of current and LM35 take the readings of temperature. All these data fed to microcontroller and microcontroller continuously compare the measured value with predetermine values if the measured value cross the specified limit then microcontroller gives command to the relay to trip immediately and through GSM the message send to the person who work on it. It will take fraction of second and motor will be completely isolate from faulty section immediately.

#### 6. ADDITIONAL CIRCUIT

- Tachometer

#### 7. CONCLUSIONS

In industries due to over-voltage, Under-voltage, Over-current and over-temperature motor may get damage hence this paper has successfully present reliable, fast and efficient system for induction motor protection this system can be implemented in any industries where the protection of motor is essential requirement. The thesis is based on protection of 3 phase induction motor under faulty condition and it is implemented using PIC microcontroller, relay driver circuit and CT's.

#### REFERENCES

- [1] Prof. Ms Madhuri Zumbre, Mr. vivek waiphale, Ms. Bhupali kumbhar" [volume: 3 Issue 11] "microcontroller based protection and control of 3 phase induction motor "International journal on recent and innovation trends in computing and communication.
- [2] Harsha Jain, Surbhi Shrivastava [volume, issue 6, June 2016] "Modern method for protection of induction motor using microcontroller and wifi technology" International Journal Of innovation research in computer and communication engineering.
- [3] Ramazan Bayindir, Ibrahim Sefa,,IlhamiColak, and AskinBektas [Vol. 23 NO.3 SEPTEMBER 2008.] "Fault Detection and Protection of Induction motor using sensor" IEEE Transactions on Energy Conversion,
- [4] Patil smeeta jaywant, Patil sachin sambhaji, Patil pragati Deepak [Vol3, issue 8, August 2014]"For detection and correction of 3phase induction motor" international journal of advance research in electronics and communication engineering (IJARECE).