

SANCTIONED LOAD MONITORING AND CONTROL SYSTEM USING PLC & SCADA

Chaudhari Digvijay O.¹, Pipada Shubham K.², Shinde Gauri S.³, S.K. Jadhav⁴

^{1,2,3}students, Department of Electronics & Telecommunication Engineering Jawahar Education Society's, Institute of Technology Management and Research, Nashik, Maharashtra, India

⁴Professor, Department of Electronics & Telecommunication Engineering Jawahar Education Society's, Institute of Technology Management and Research, Nashik, Maharashtra India

Abstract - The world is facing a severe power shortage because the generation of power is less than the power consumption due to increasing demand from the consumer's side. Due to this, the situation of unbalance in power distribution occurs, which directly or indirectly elects the growth of the nation by electing the industries, orcs etc. To overcome the problem of power distribution, we can manage the equitable power distribution by using Programmable Logic Controller (PLC). The aim of this project is to mainly monitor power consumption by different end users. If the consumer exceeds the limit of the sanctioned load, the supply of that consumer is disconnected by using the Programmable Logic Controller (PLC) through a relay installed in the energy meter. We use PLC as the communication medium between the different types of consumers, i.e. (Residential, Commercial, and Industrial) and the control room of power distribution. This system will monitor the supply of sanctioned loads for deferent users. The main application of this project is to control the demand and supply balance of power in a distribution system.

Keywords: Programmable Logic controller, Sensor, Circuit Breakers and SCADA.

1 INTRODUCTION

Today, the world is facing the most critical problem of inadequacy in power supply. The electricity demand is increasing with the growth of population and with the use of different appliances in the household. So, there is a need for the consumers to track their daily power usage and understand the consumption patterns to save and control these resources. In many countries including India, the primary need of electricity of the consumers is not filled due to the over consumption of power by some users than the power sanctioned by the power supply providers. The energy consumption is justice by the men need of having a comfortable survival, thus, the production, generation and power management is a clearly relevant and vital fact.

Now-a-days people expend electricity without care about the availability of power. As a result, the production ability does not match the demand. The global energy crises are increasing at an alarming rate and has the attention towards more and more energy production. Since one becomes wiser in using electricity one can instantly know

how much to use and consume. Instead, we can use the power available in such a way that the user will only use the power which is allocated to the user according to the limit of sanctioned load provided by the service provider. A properly installed and monitoring system is a valuable advantage to almost any type of energy consumer by avoiding the power theft and unorganised power management due to lack of sufficient and efficient past energy consumption data, that has led to huge losses to power companies or unbearable high electricity cost for the customers. thus losses in production in general, there are three basic categories of consumers: industrial, commercial and residential. Each consumer has a different objective for energy consumption. But now a day there is no arrangement for the detection of running load at the domestic level so that the service provider can calculate the load automatically. A lot of new technology has been introduced to satisfy the user demands.

2 LITERATUR SURVAY

In order to start the thesis, the first step is to study the previous work performed by researchers. For this purpose, various papers have been studied.

Heavy power consumer (Industrial applications) has to pay the fixed charges irrespective of the consumed power. Also, penalty is levied on such consumptions even if there is a slight overshoot in maximum consumption limit. There will not be any prior notification with this regard. In such situation, this implementation aims in providing details of overshoot time, peak power consumption, displaying the power consumption and the cost based on the tariff plans from any remote location. [1]

In the current financial climate, focus on energy saving within the home has intensified by the desire to reduce costs. Fossil fuel savings, carbon emission reductions, as well as a permanent fall in electricity prices, are significant incentives for the residential consumers to look at different methods to reduce their energy consumption. Demand Response (DR) is an alternative method which provides an opportunity for consumers to reduce their energy consumption cost by deferring or shifting their electricity usage during peak periods. To this aim, this study evaluates the effectiveness of price-based DR techniques currently available in Western Australia based

on the consumers cost of electricity and comfort level. The electricity tariffs are systematically examined. [2]

Next generation Smart Cities have the potential to enhance the citizen’s quality of life and to reduce the overall energy expenditure. In particular, emerging smart metering technologies promise to greatly increase energy efficiency in the residential and industrial areas. In this context, new power metering methods such as Non-Intrusive Load Monitoring (NILM) can provide important real-time information about the contribution of any single appliance. In this paper, we present a complete hardware-software design that concentrates locally an efficient event-based supervised NILM algorithm for load disaggregation. This new kind of power analysis, which usually requires high computing capability, is executed real-time on a low-cost and easy-to-install smart meter ready for the Internet of Things (IoT). [3]

Non-intrusive load monitoring is an important development direction of electric load monitoring. Traditional NILM mainly track and decompose the power voltage current, and other transient or steady-state parameters like power parameters at the monitoring system entrance, and then identify the specific type of load. The load identification method is complicated, and there are limitations on identifying multiple devices switching simultaneously. This paper studied on NILM oriented residential load identification methods and proposed one based on period gram, and then made the detailed theoretical analysis and simulation verification of the selection and determination of electric appliances characteristic model. [4]

3 PROPOSED SYSTEM

In this proposed method, a new protection method based on a programmable logic controller (PLC) has been introduced. This system has the ability to control the data of remote locations and also provides the proper monitoring results. So here we are trying to make a system in which a sensor will be installed in the house of the user and if the user exceeds the limit of power consumption than the sanctioned power, then that consumer will be automatically warned 3 times and if the consumer still keeps on exceeding the limit, then the power supplied will be automatically cut-off and will have to pay the penalty to the service provider that the consumer is abide to. And then only after paying the penalty, the power supply of that consumer will be resumed again by a control switch located in the service providers control room.

3.1 Block Diagram of Proposed System

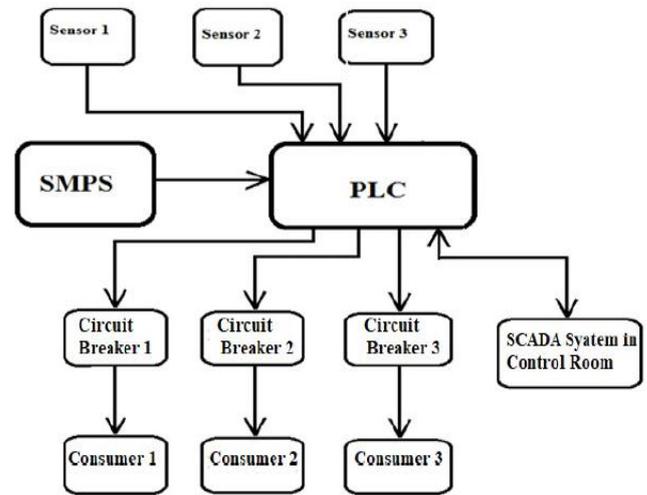


Fig No 1 Block Diagram

3.2 Working

The system designed is used for monitoring the load exceeding parameter. For monitoring it, 3 loads as 3 consumers are assumed to be having their particular values of sanctioned load. Power is being supplied to these loads. In the hardware part there is the use of the current sensors that will sense the changes in the power consumed by the load. It will continuously monitor the power used by the consumers. If the limits of power usage will be exceeded, then the current sensor will sense it and give the signal to the PLC, and then accordingly, the PLC will take the actions. Here the PLC used is Delta DVP14SS2 which is connected with a SCADA by RS485 serial communication for the communication with software part, so that the system will be monitored and controlled easily and fast. The actions will be like rusty ringing the buzzer son exceeding the limits of sanctioned load. These buzzers will keep on ringing for 10 seconds.

The consumers should lower down their loads within 10 seconds. If the consumer does so, then it will be considered as the warning. Likewise, maximum of three warnings will be given every time the consumer exceeds the limit. After the third warning, again if the consumer exceeds the limit then, the power supplied to the consumer will be cut_ and to again resume the power, the consumer will have to pay the penalty that will be issued. And then with the help of SCADA, that will keep the data that is the records of the consumers, the power will again be supplied. Another action is related to the first action described. Action performed will be like if the consumer exceeds the limit of sanctioned load, and even after the 10 seconds of buzzer ringing that will be indicated as warning, if the consumer does not lower down the load within 10 seconds, then the power supplied will directly be cut-off.

3.2.1 PLC

The PLC used here is Delta DVP14SS2 which has 8 digital inputs and 6 outputs which requires 20.4V to 28.8V dc supply for its operation.

3.2.2 Current Sensors

The current sensors used in the project are WCS2202, which can sense up to 0.30V current at 5V supply.

3.2.3 SMPS

The SMPS that used in the system is of P-zone that has maximum range of 140-300V input voltage and up to 2A maximum output current.

3.2.4 Relay

The relays used are 24V and 5V dc used for switching action for PLC and to cut-off the power supplied to the loads.

3.2.5 ULN2003A

This is a relay driver IC which provides the required voltage for the relays to turn ON/OFF. It is a IC chip with high voltage/ high current Darlington transistor array. They can have output up to 50V. Also they have output fly back diodes.

4. CIRCUIT DIGRAM

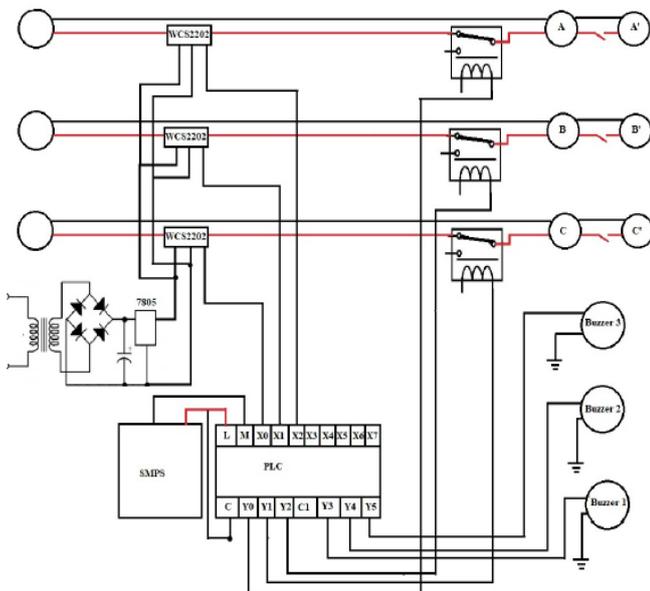


Fig No 2 Circuit Diagram

4.1 Circuit Diagram Description

In the circuit there are two parts, one is power circuit and another is control circuit. Power circuit is 230 V ac supply to load which is operating 3 Loads and control circuit is

the controlling and sensing circuit of whole system. An SMPS of 24V DC is connected which is used to power up the PLC and operate Relays and Buzzers. Another power supply of 5V is used for current sensors. Through this supply power is given to current sensor which is connected to comparator circuit. If the current is exceeded by a certain value, the comparator circuit gives a digital signal to relay driver IC and respective relay for the operation of the current sensor. Relay switches 8 supply to 24V and digital 24V which is required for PLC input is Switched for Input. Whenever 24V reaches to the PLC input the PLC executed further operation and according to program it turns on the Buzzer which is powered up with 24V DC supply. If same input is continuously ON for 10 sec or Input gets high for 3 times, the PLC turns on the relay which is connected across the power Circuit and respective load is turned off. The same signal is transmitted to the SCADA by serial communication RS485 and the Reset signal is also generated from SCADA.

4.2 Flowchart

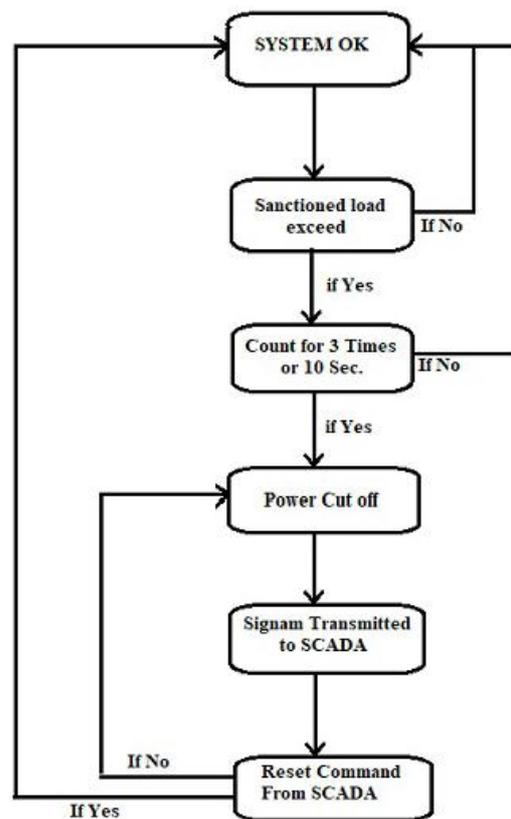


Fig No 3 Flow Diagram

5 SOFTWARE DETAILS

5.1 WPL SOFT:

The WPL soft is software used to Program Delta PLC. This software was developed to work on Windows XP, Windows Vista, Windows 7, Windows 8 or Windows 10 and can function on 32-bit systems. WPLSoft.exe, Wpl.exe,

WPL209.exe, WPL208.exe or WPL207.exe are the common names to indicate this program's installer.

5.2 WONDERWARE INTOUCH

Wonder ware In Touch is award-winning HMI visualization software that empowers customers to achieve their quest for operational excellence.

5.3 KEP SERVER

KEPServerEX is the industry's leading connectivity platform that provides a single source of industrial automation data to all of your applications. The platform design allows users to connect, manage, monitor, and control diverse automation devices and software applications through one intuitive user interface.

6 IMPLEMENTATION AND RESULTS

In proposed system, each consumer is being sanctioned load limit of 100Watt. In order to obtain the results, following conditions can be considered.

1. Case: The loads that the consumers have connected are of 60Watt while the sanctioned load limit is of 100Watt. Since the loads are consuming the power below their sanctioned limits, as a result of it all the three sanctioned loads(bulbs) are glowing. This is the expected scenario.




Case :1 Expected Scenario

- 2 Case: In Second case extra load is of 200Watt is used. Resultant total of 260Watt is being connected to the system which is way too much than the sanctioned limit of 100Watt. The consumer is expected to lower down its exceeding load within 10 seconds for which the PLC is being programmed. Otherwise the power supplied to the consumer will be directly cut on cut-off.



Case: 2 Cut off Condition

- 3 Case: If the consumer fails to maintain its sanctioned load limit, then to again resume its connection, the consumer needs to approach the power supply distributor who can resume the supply.

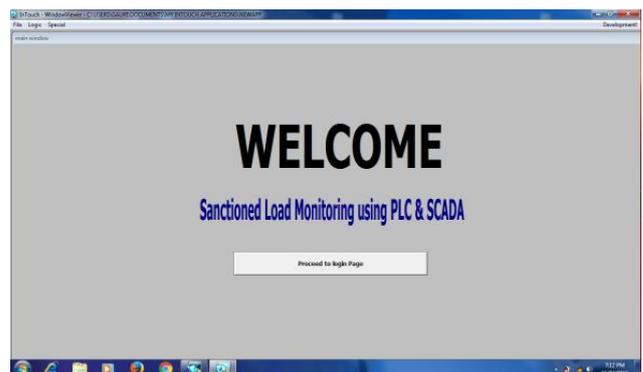


Case: 3 Welcome Window

- 4 Case: Only after the consumer pays the penalty, the distributor will do the login by providing its user-id and password for completing the authentication process with the SCADA system.



Case: 4.1 Login Window

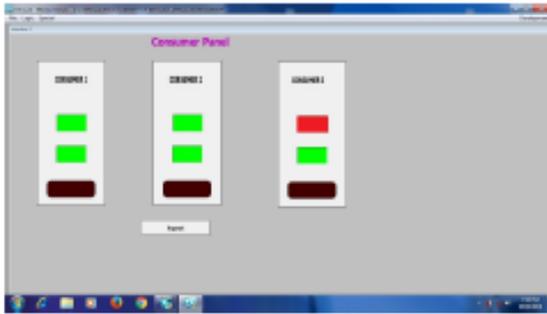

Case: 4.2 Consumers Record Window

7 CONCLUSION

The objective of proposed project is to make the system more accurate and the alertness and awareness about the sanctioned load and connected load thus will increase because of the instant action that will be taken by the system. The system which is implemented can distribute the power to the consumer ends. It can monitor the power distribution which is being distributed to the consumers and control the excessive usage of power.

8 FUTURE SCOPE

- Number of consumers can be increased.
- Accurate penalties can be charged and accepted from the exact consumer.
- Along with the proposed system we can install a small system that would be a combination of automatic penalty receipt generation and the receipt scanning system, that will generate the penalty receipt with bar codes and after the payment of the penalty.
- To improve the proposed system function, a microcontroller based, GSM interfaced system can be installed that would notify the consumer regarding the over usage of power by sending messages.

9 ACKNOWLEDGEMENTS

Sincere thanks to all the anonymous researchers for providing such a useful and helpful opinion, findings, conclusions and recommendations. Also gives immense pleasure to thanks to Project coordinator / HOD Prof. S. K. Jadhav, Principal Dr. M. V. Bhatkar and friends for their kind support and guidance.

REFERENCES

[1] Rahulkrishna P K , Eshwari R, Shree Harsha N J and Rajeshwari Hegde. \Design and Development of Remote Load Monitoring Suitable For Non-Residential Loads Through Wireless Data Transmission".IEEE May 2016.

[2] Australian Energy Market Commission. Final Report on \Power of choice review- giving consumers options in the way they use electricity", IEEE 2012.

[3] Md Moktadir Rahman, Cindy Van Heerden\Electricity Tari_s Evaluation using Smart Load Monitoring Devices for Residential Consumer", IEEE 2016.

[4] Han Lu , Wu Xin , Bai Hui , Qi Bing , Zheng Aixia \ A residential load identi_cation algorithm based on periodogram for non-intrusive load monitoring", Paper No. CP1057,IEEE August 2016.

[5] S. ELAKSHUMI, A. PONRAJ\ A Server Based Load Analysis Of Smart Meter Systems",IEEE March 2017.

[6] Shruti Ranjan Mini S. Thomas, \An e_cient home energy management algorithm for demand response analysis in Indian scenario", IEEE June 2015.

[7] Mohamed Nail Meziane Mohamed Nail MezianePhilippe Ravier,Guy Lamarque,lean-Charles Le Bunetelt and Yves Ringeaudt,\ high accuracy event detection for non-intrusive load monitoring",june 2017.

[8] Dr. Syed Faiz Ahmed,Dr. Hazry Desa,Dr. Fahad Azim,Ammar Surti,Waqas Hussain, University Malaysia Perlis, Malaysia,\Remote Access of SCADA with Online Video Streaming", The 8th International Conference on Computer Science & Education (ICCSE 2013) April 26-28 2013.

[9] Xiaojing Wang, Dongmei Lei, Jing Yong, Liqiang Zeng, Sam West,\An Online Load Identi_cation Algorithm for Non-Intrusive Load Monitoring in Homes", August 2013.

[10] N.M.Sapari, H. Mokhlis, A.H.A. Bakar, M.R.M.Dahalan,\Online Stability Index Monitoring for Load Shedding Scheme in Islanded Distribution Network", 2014 IEEE 8th